


SIZE	BY PASS	L1	W1	H1
3"	2"	8'-8"	4'-8"	4'-6"
4"	2"	8'-8"	4'-8"	4'-6"
6"	4"	11'-0"	6'-0"	4'-6"

PLAN VIEW

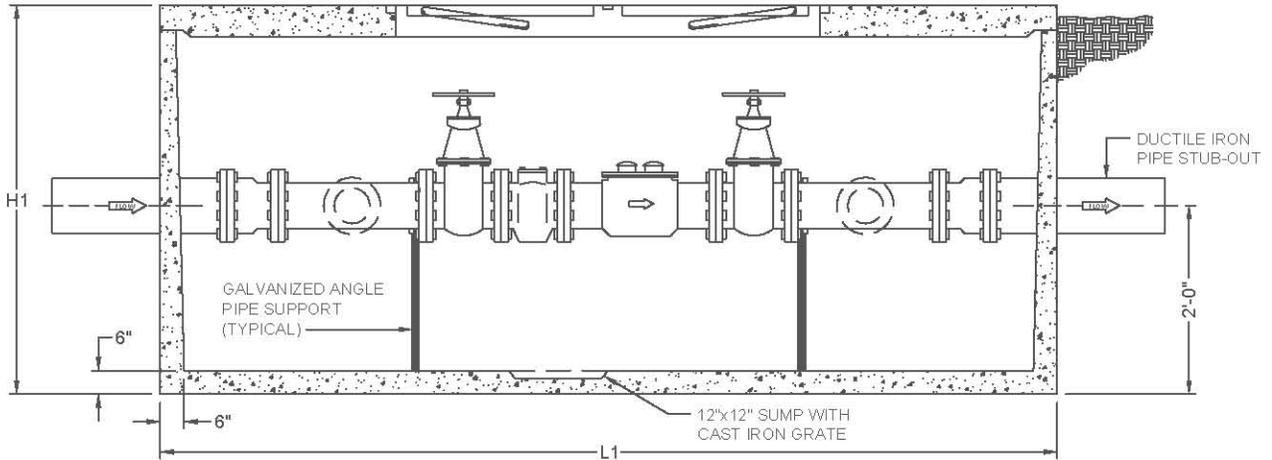

ELEVATION

PIPE AND FITTINGS SHALL BE DUCTILE IRON

SPECIFICATIONS

CONCRETE:

CLASS 1 CONCRETE WITH DESIGN STRENGTH OF 4500 PSI AT 28 DAYS. UNIT IS OF MONOLITHIC CONSTRUCTION AT FLOOR AND FIRST STAGE OF WALL WITH SECTIONAL RISER TO REQUIRED DEPTH.

REINFORCEMENT:

GRADE 60 REINFORCEMENT. STEEL BAR CONFORMING TO ASTM A615 ON REQUIRED CENTERS OR EQUAL.

NOT TO SCALE



ENGINEERING & PUBLIC WORKS

TYPICAL COMMERCIAL WATER METER VAULT

APPROVED BY: *Andrew B. Stone*
Andrew B. Stone, PE, City Engineer & Director of Public Works

STD. DRAWING #:

303

DRAWN BY: Alex Ray, EI

DATE: 8/16/12