


PLAN VIEW

BYPASS CONNECTION & RECIRCULATION PIPING NOT SHOWN FOR CLARITY

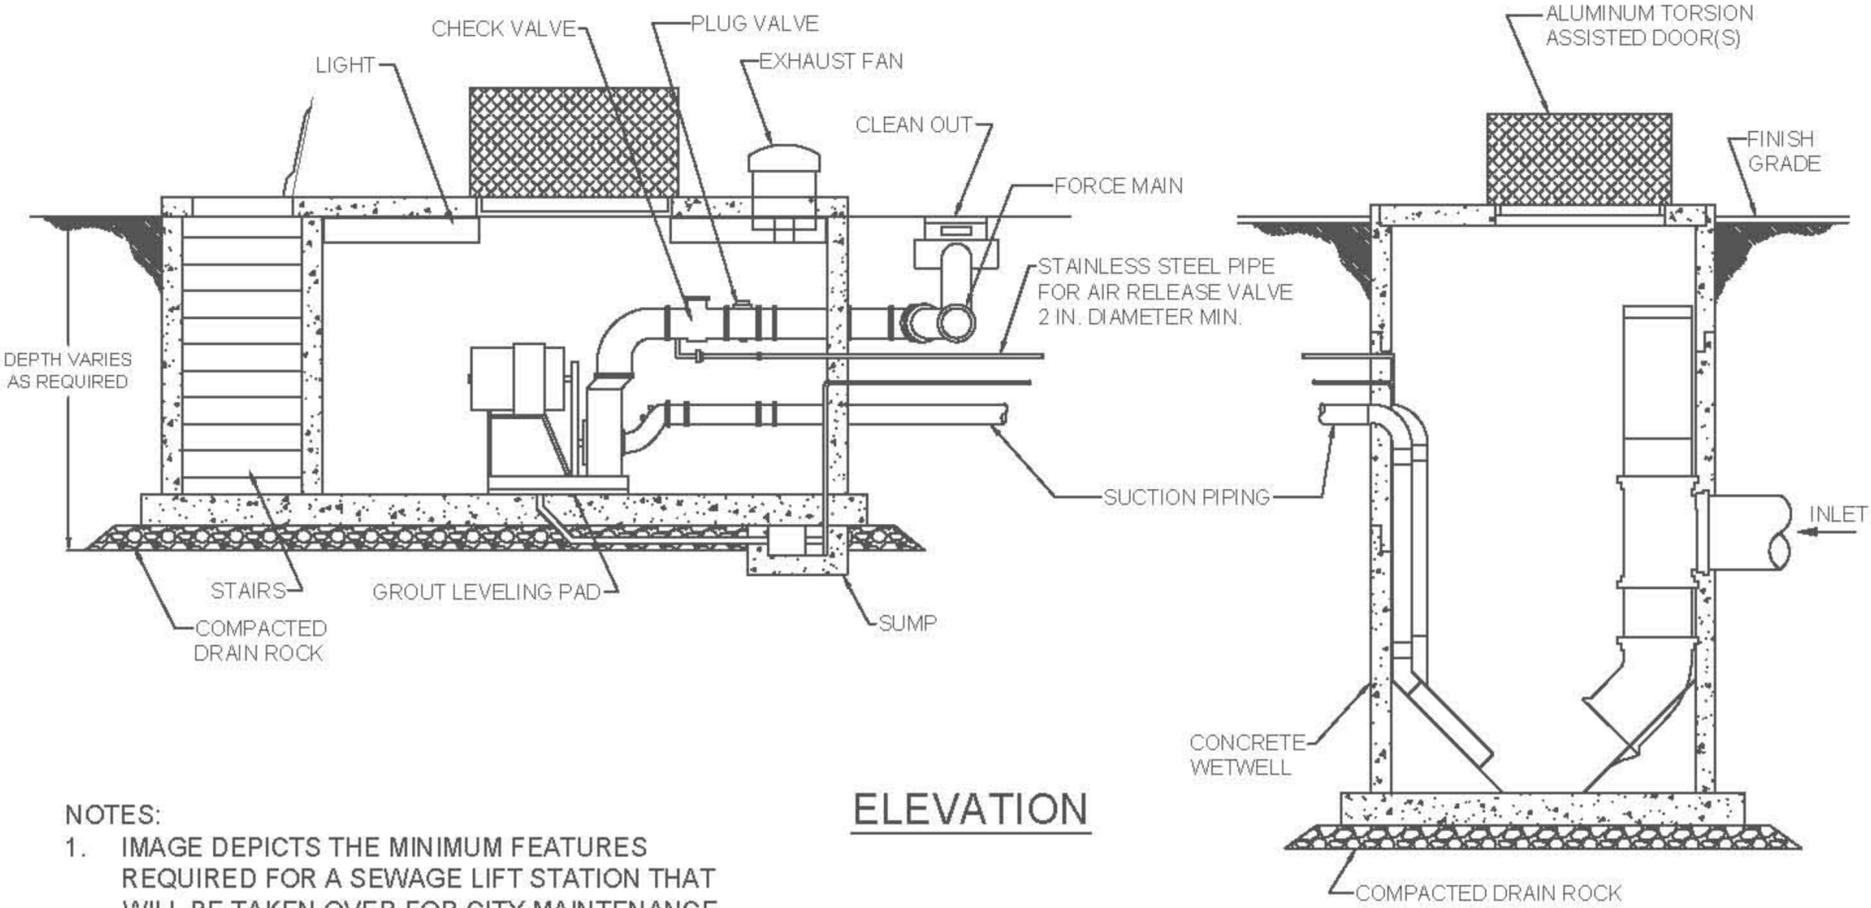

ELEVATION

NOTES:

1. IMAGE DEPICTS THE MINIMUM FEATURES REQUIRED FOR A SEWAGE LIFT STATION THAT WILL BE TAKEN OVER FOR CITY MAINTENANCE.
2. POWER REQUIREMENT: 480 V, 3-PHASE, GENERATOR PLUG AND TRANSFER SWITCH READY.
3. FINAL DESIGN MUST BE SITE SPECIFIC AND PREPARED BY A REGISTERED PROFESSIONAL ENGINEER.

NOT TO SCALE



CITY-MAINTAINED BELOW GRADE SELF PRIMING PUMPING STATION

APPROVED BY: *Andrew B. Stone*
 Andrew B. Stone, PE, City Engineer & Director of Public Works

STD. DRAWING #:

508

DRAWN BY: Alex Ray, EI

DATE: 8/16/12